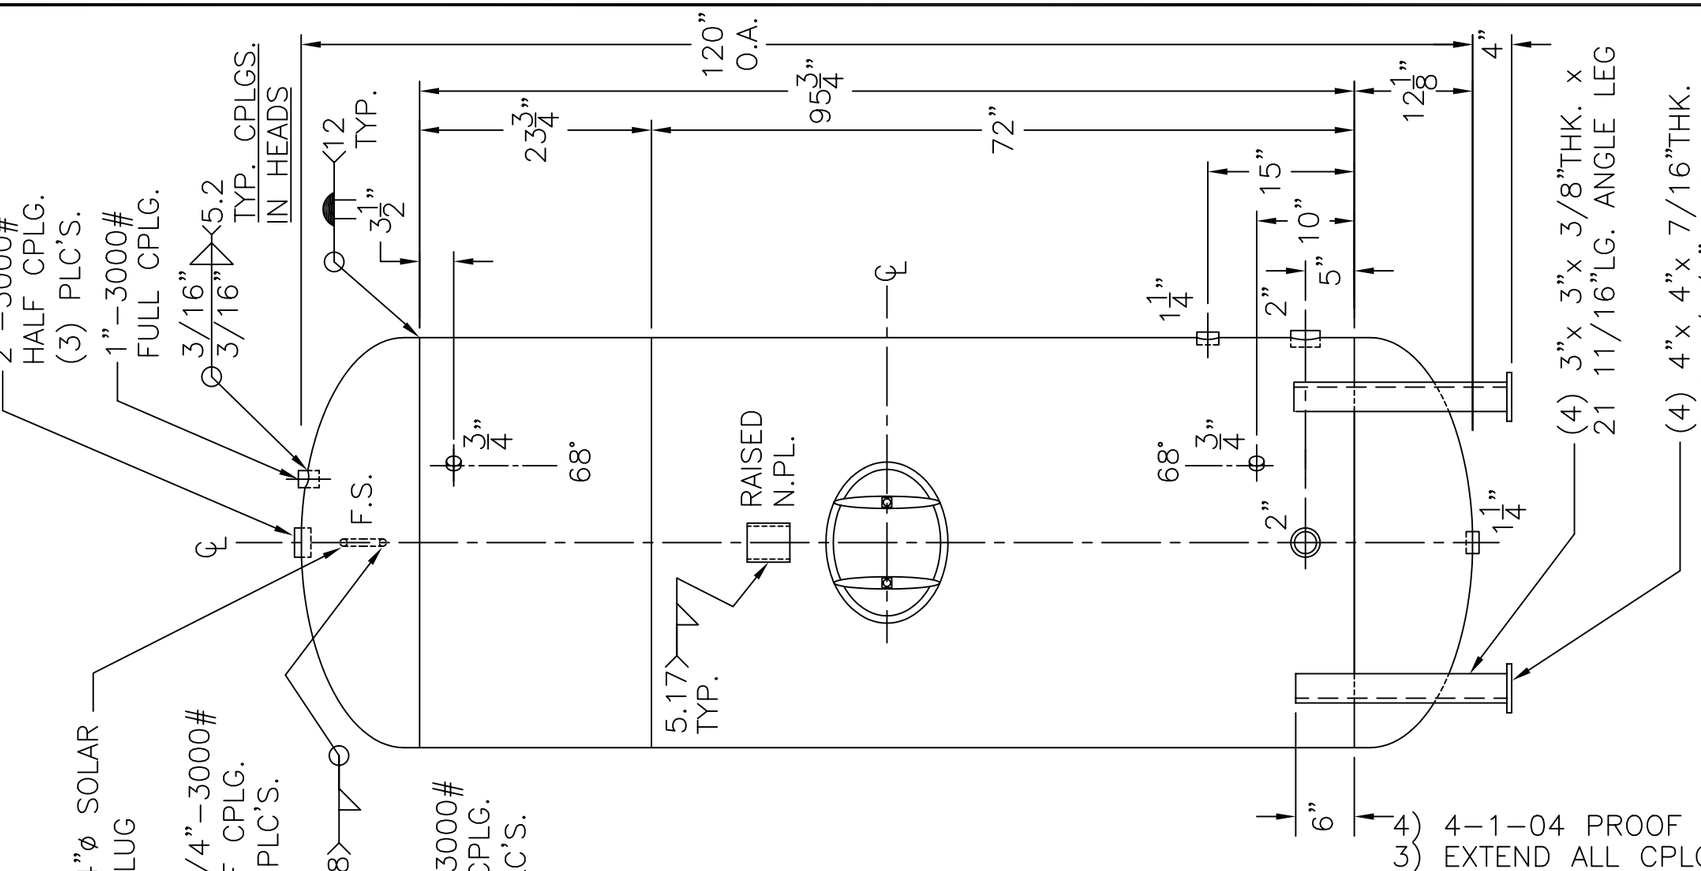

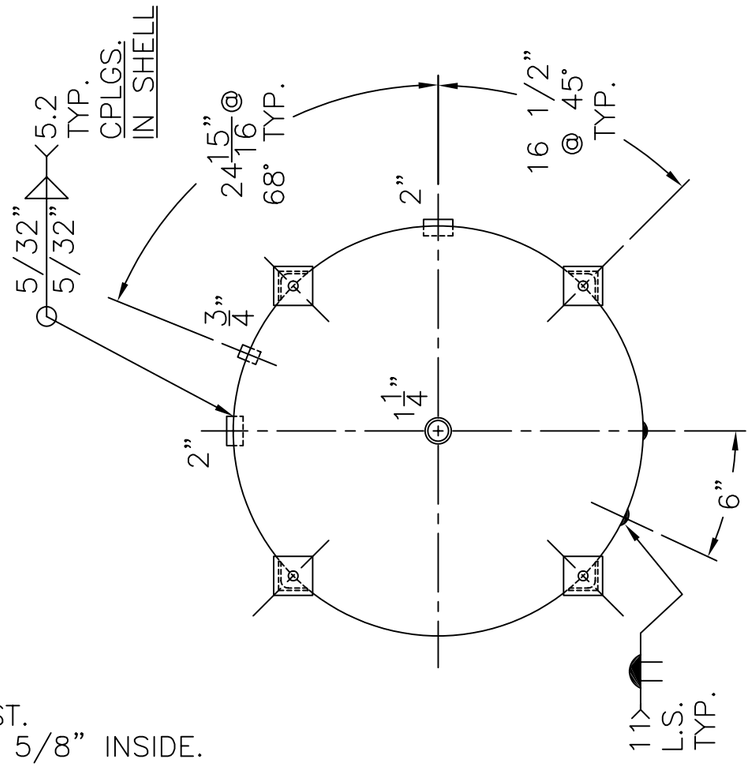

4) 4–1–04 PROOF TEST.
3) EXTEND ALL CPLG'S 5/8" INSIDE.
2) HYDRO @ 240 PSIG.
NOTE. 1) SEAL ALL OPENINGS TO KEEP CEMENT MOIST TO PREVENT CRACKING.

SHELL / HEADS	.205" SA–455 2:1 S.E.
	JOGGLE
	.175" SA–414–G
M.A.W.P. 160 PSIG. @ 210 °F	
ASME. SECTION IV 2001 ADD 2003	
X–RAY: RT–NO / H.L.W.	
GALLONS: 660	WT. 1898 LBS.
SERIAL NO.	
N.B.	

CS–42–660–V

REV. 10–7–04

DATE: 5–21–96

FOR: HANSON STANDARD

VERT. HOT WATER TANK

115.8 SQ. FT. SURFACE AREA.

THIS TANK IS SHIPPED WITH ALL OPENINGS SEALED. THE CEMENT LINING MUST BE KEPT MOIST BEFORE, DURING, AND AFTER INSTALLATION TO PREVENT CRACKING OF THE CEMENT.

INSIDE: CEMENT LINED

OUTSIDE: PRIME

(632) LEG ZONE: 4–15 KM.

CAD "B" UNDER "STD"–SERIES

BY: J.G. SCALE: 3/4"=12"

ROY E. HANSON JR. MFG.
1924 COMPTON AVE.
LOS ANGELES, CA 90011